
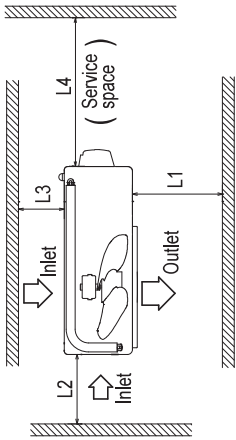


Models SRC50ZSX-W, 60ZSX-W

Symbol	Content
A	Service valve connection (gas side) φ12.7 (1/2") (Flare)
B	Service valve connection (liquid side) φ6.35 (1/4") (Flare)
C	Pipe / cable draw-out hole
D	Drain discharge hole φ20×5 places
E	Anchor bolt hole M10-12×4 places

Notes



- (1) The unit must not be surrounded by walls on the four sides.
- (2) The unit must be fixed with anchor bolts. An anchor bolt must not protrude more than 15mm.
- (3) If the unit is installed in the location where there is a possibility of strong winds, place the unit such that the direction of air from the outlet gets perpendicular to the wind direction.
- (4) Leave 200mm or more space above the unit.
- (5) The wall height on the outlet side should be 1200mm or less.
- (6) The model name label is attached on the front side of the unit.

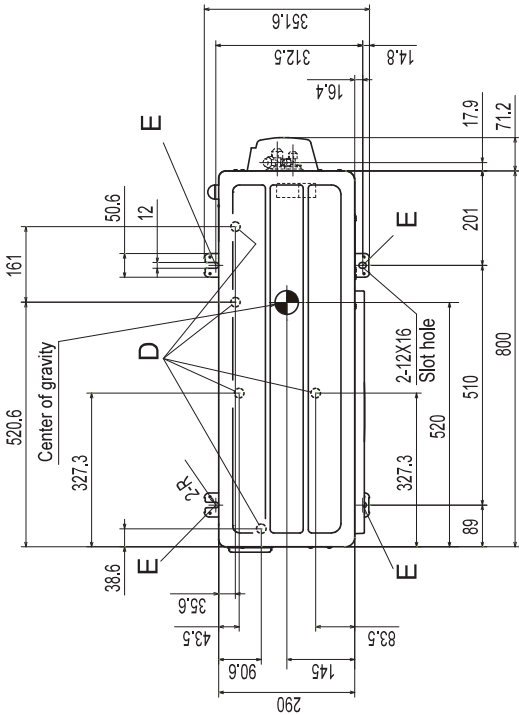

Minimum installation space

Examples installation	I	II	III	IV
Size	Open	280	280	180
L1	100	75	Open	Open
L2	100	80	80	80
L3	250	Open	250	Open
L4				

Unit:mm

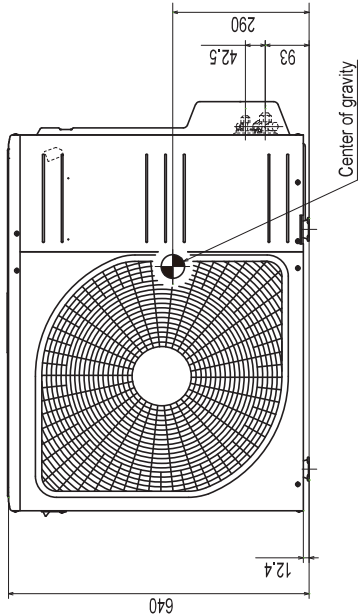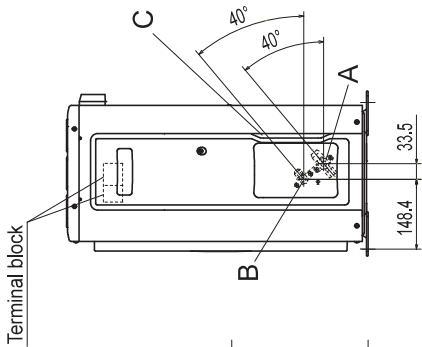

(3) Remote control

(a) Wireless remote control

Unit : mm

